

RG-08 : SE-330 NEUTRAL-GROUNDING-RESISTOR MONITOR SETTINGS

SE-330 Model Number: SE-330 - ____ - ____

SE-330 Serial Number: _____ Revision: _____

Substation Identification: _____

Transformer Specifications: _____

SE-330 Communications

Check One	
☐	Local USB
☐	Other: _____

Current Transformer

Check One	
☐	EFCT (5-A primary rating when connected to sensitive input)
☐	SE-CS30 (30-A primary rating when connected to sensitive input)
☐	Other: _____

Current Transformer Connection

Check One	
☐	Sensitive Input (Terminals 8, 11)
☐	1-A Input (Terminals 9, 11)
☐	5-A Input (Terminals 10, 11)

Sensing Resistor

Check One	
☐	ER-600VC ☐ SE-MRE-600
☐	ER-5KV
☐	ER-5WP
☐	ER-15KV
☐	ER-25KV
☐	ER-35KV

Remote Indication

Check One	
☐	None
☐	RK-232
☐	Other: _____

NGR Ratings

Current: _____ A

Voltage: _____ V

Time: _____

Resistance _____ Ω

Serial No.: _____

Mfg.: _____

GF Trip Level

Setting: _____ % _____ A

☐ MEM Selected

GF Trip Time


Setting: _____ s

V_N Trip Level

Setting: _____ V

X 5 for 100 k Ω Sensing Resistor: _____

RG-08 : SE-330 NEUTRAL-GROUNDING-RESISTOR SETTINGS

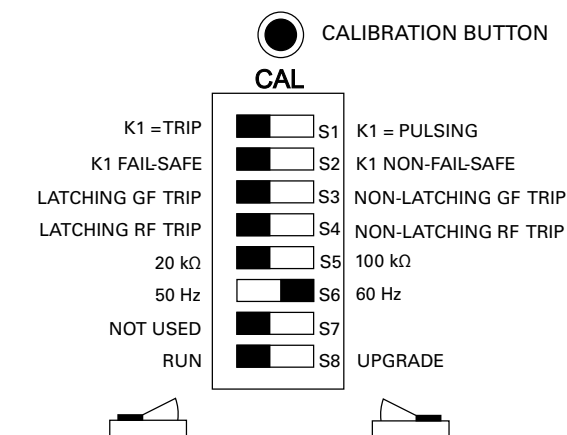

NOTE:

1. DEFAULT SETTINGS SHOWN.

Configuration Switch Settings				
		Check One		Check One
S1:	K1 = Trip		K1 = Pulsing	
S2:	K1 = Fail-Safe		K1 = Non-Fail-Safe	
S3:	Latching GF Trip		Non-Latching GF Trip	
S4:	Latching RF Trip		Non-Latching RF Trip	
S5:	20 k Ω		100 k Ω	
S6:	50 Hz		60 Hz	
S7:	Not Used			
S8:	Run		Upgrade	

System Calibration

Calibration Successful: _____

Date (YYYY-MM-DD): _____

Calibration Number (if available): _____

Software Settings				
		Check One		Check One
K2:	Fail Safe		Non-Fail Safe	
K3:	Fail Safe		Non-Fail Safe	