




TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
KLNR (1A - 15A)

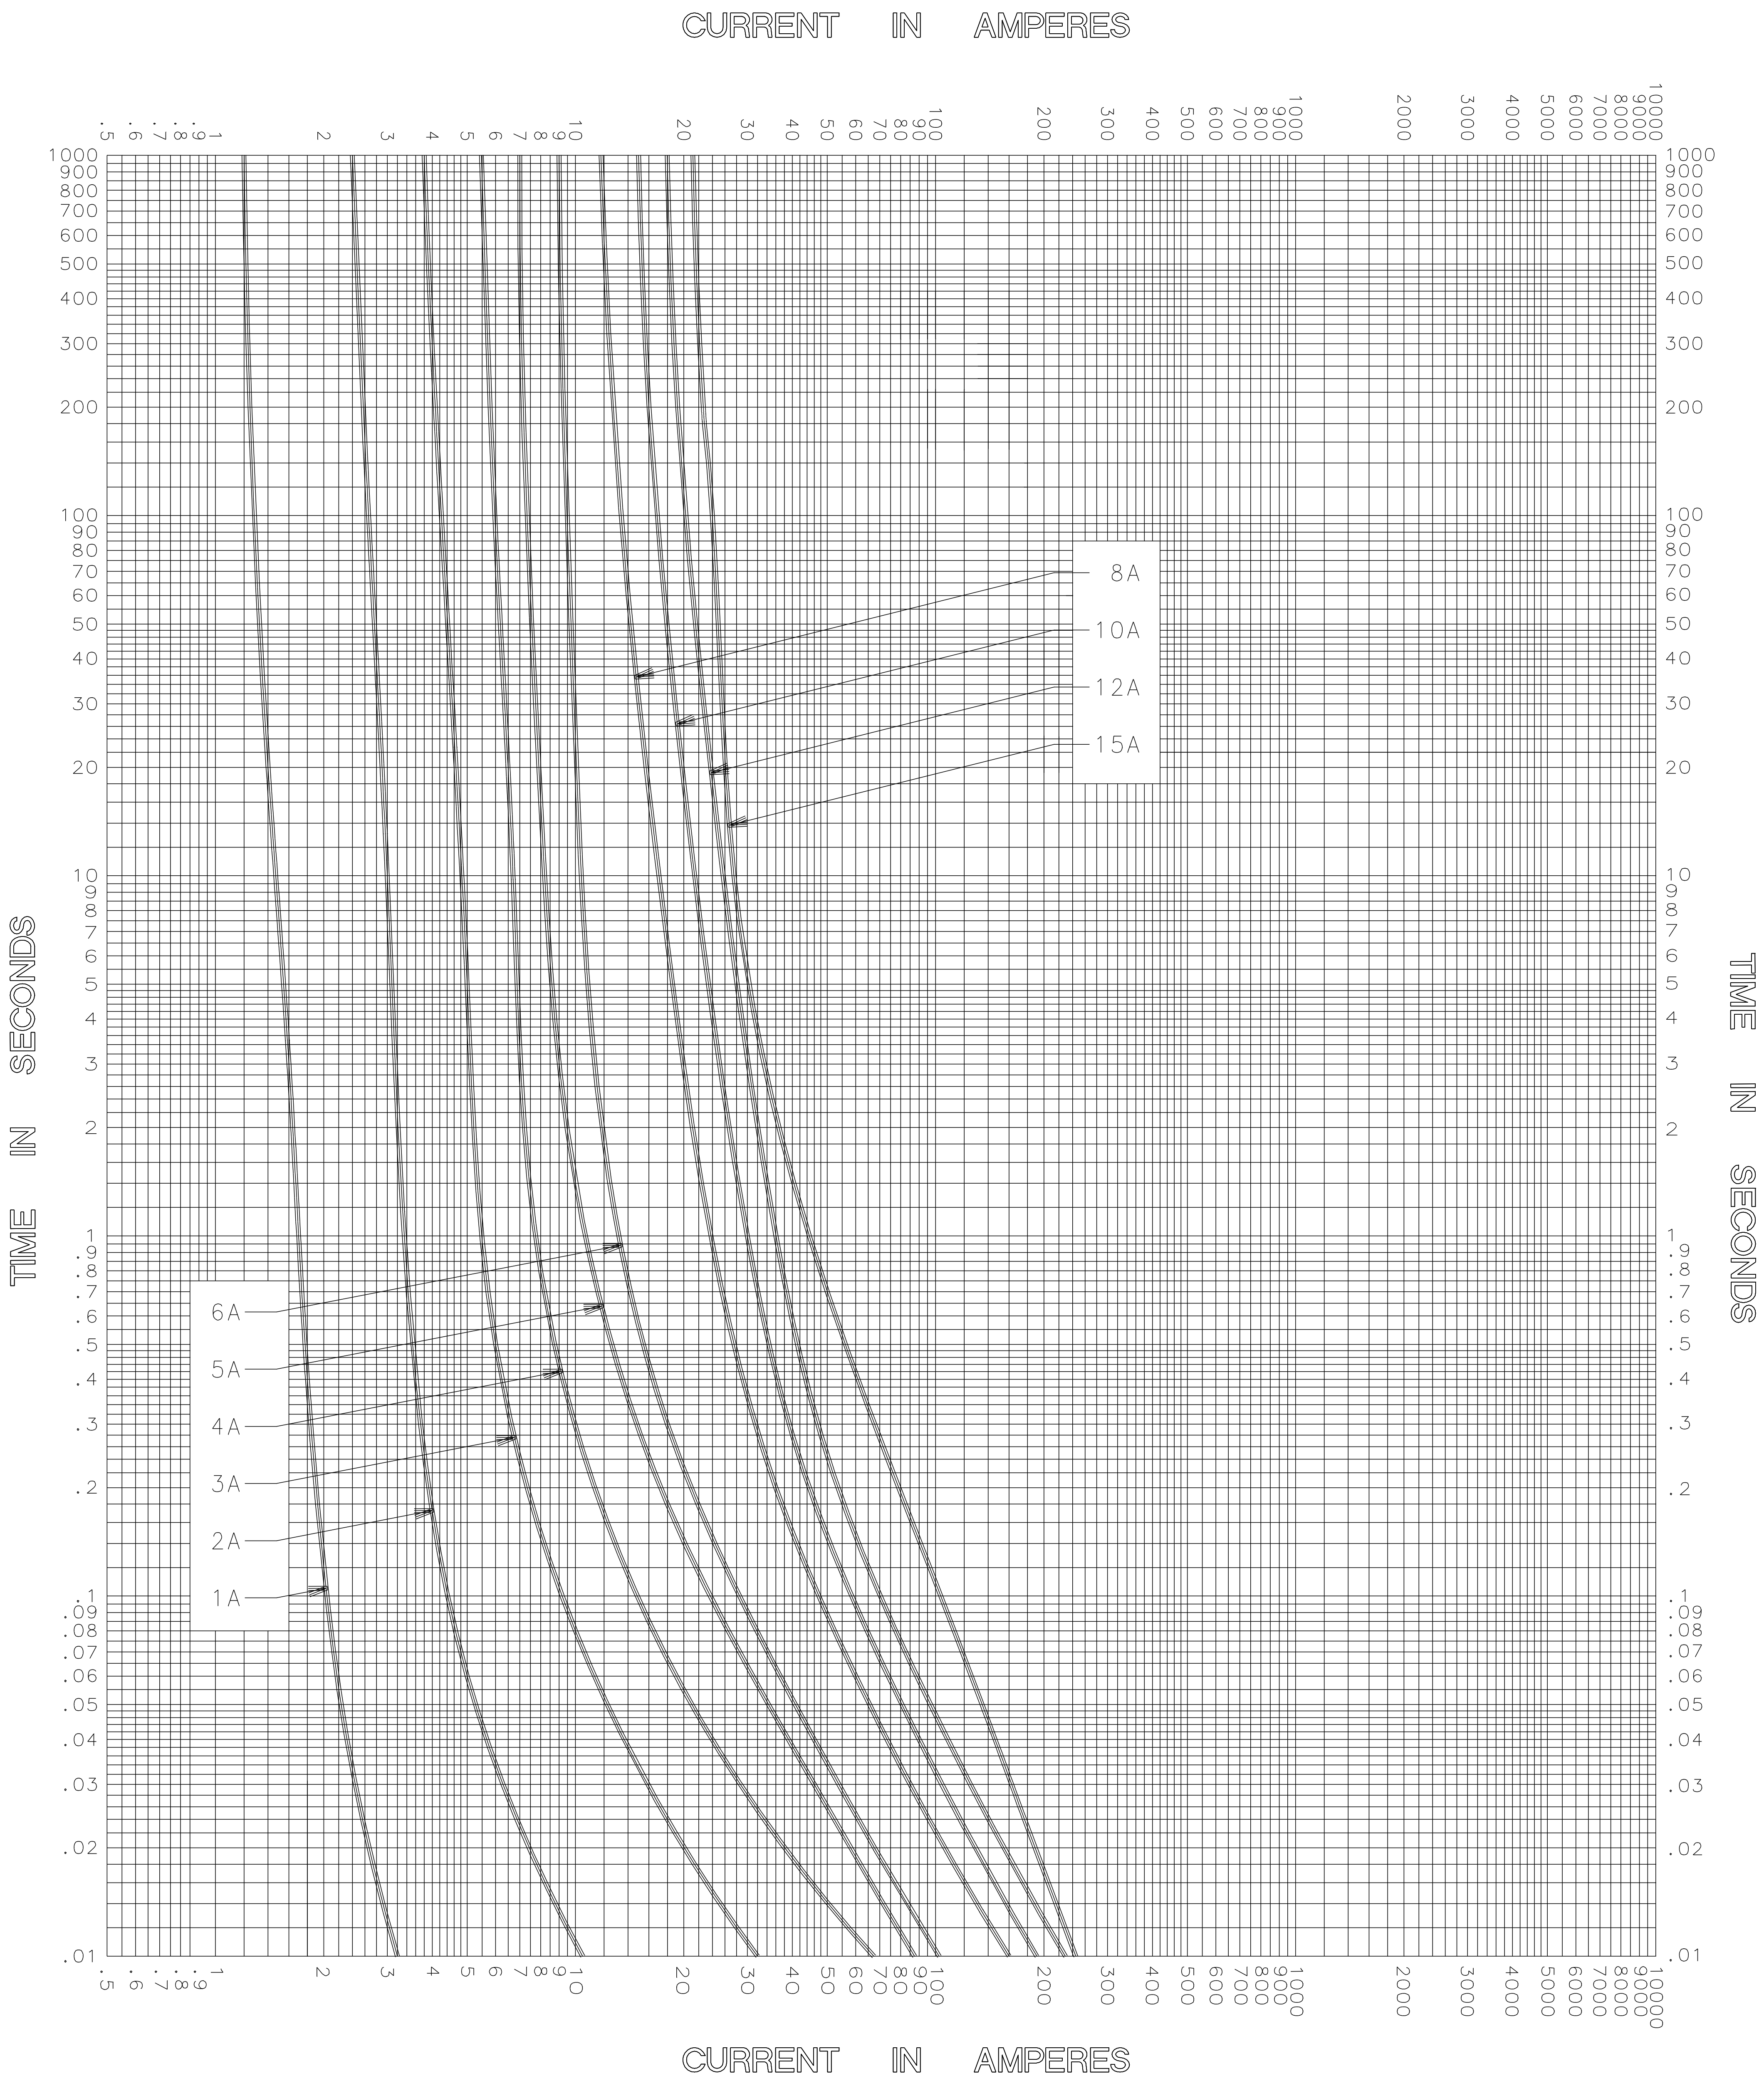

LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY MRD
DATE 02/19/03
CHECKED BY TN


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. B-FCC041 NR 001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

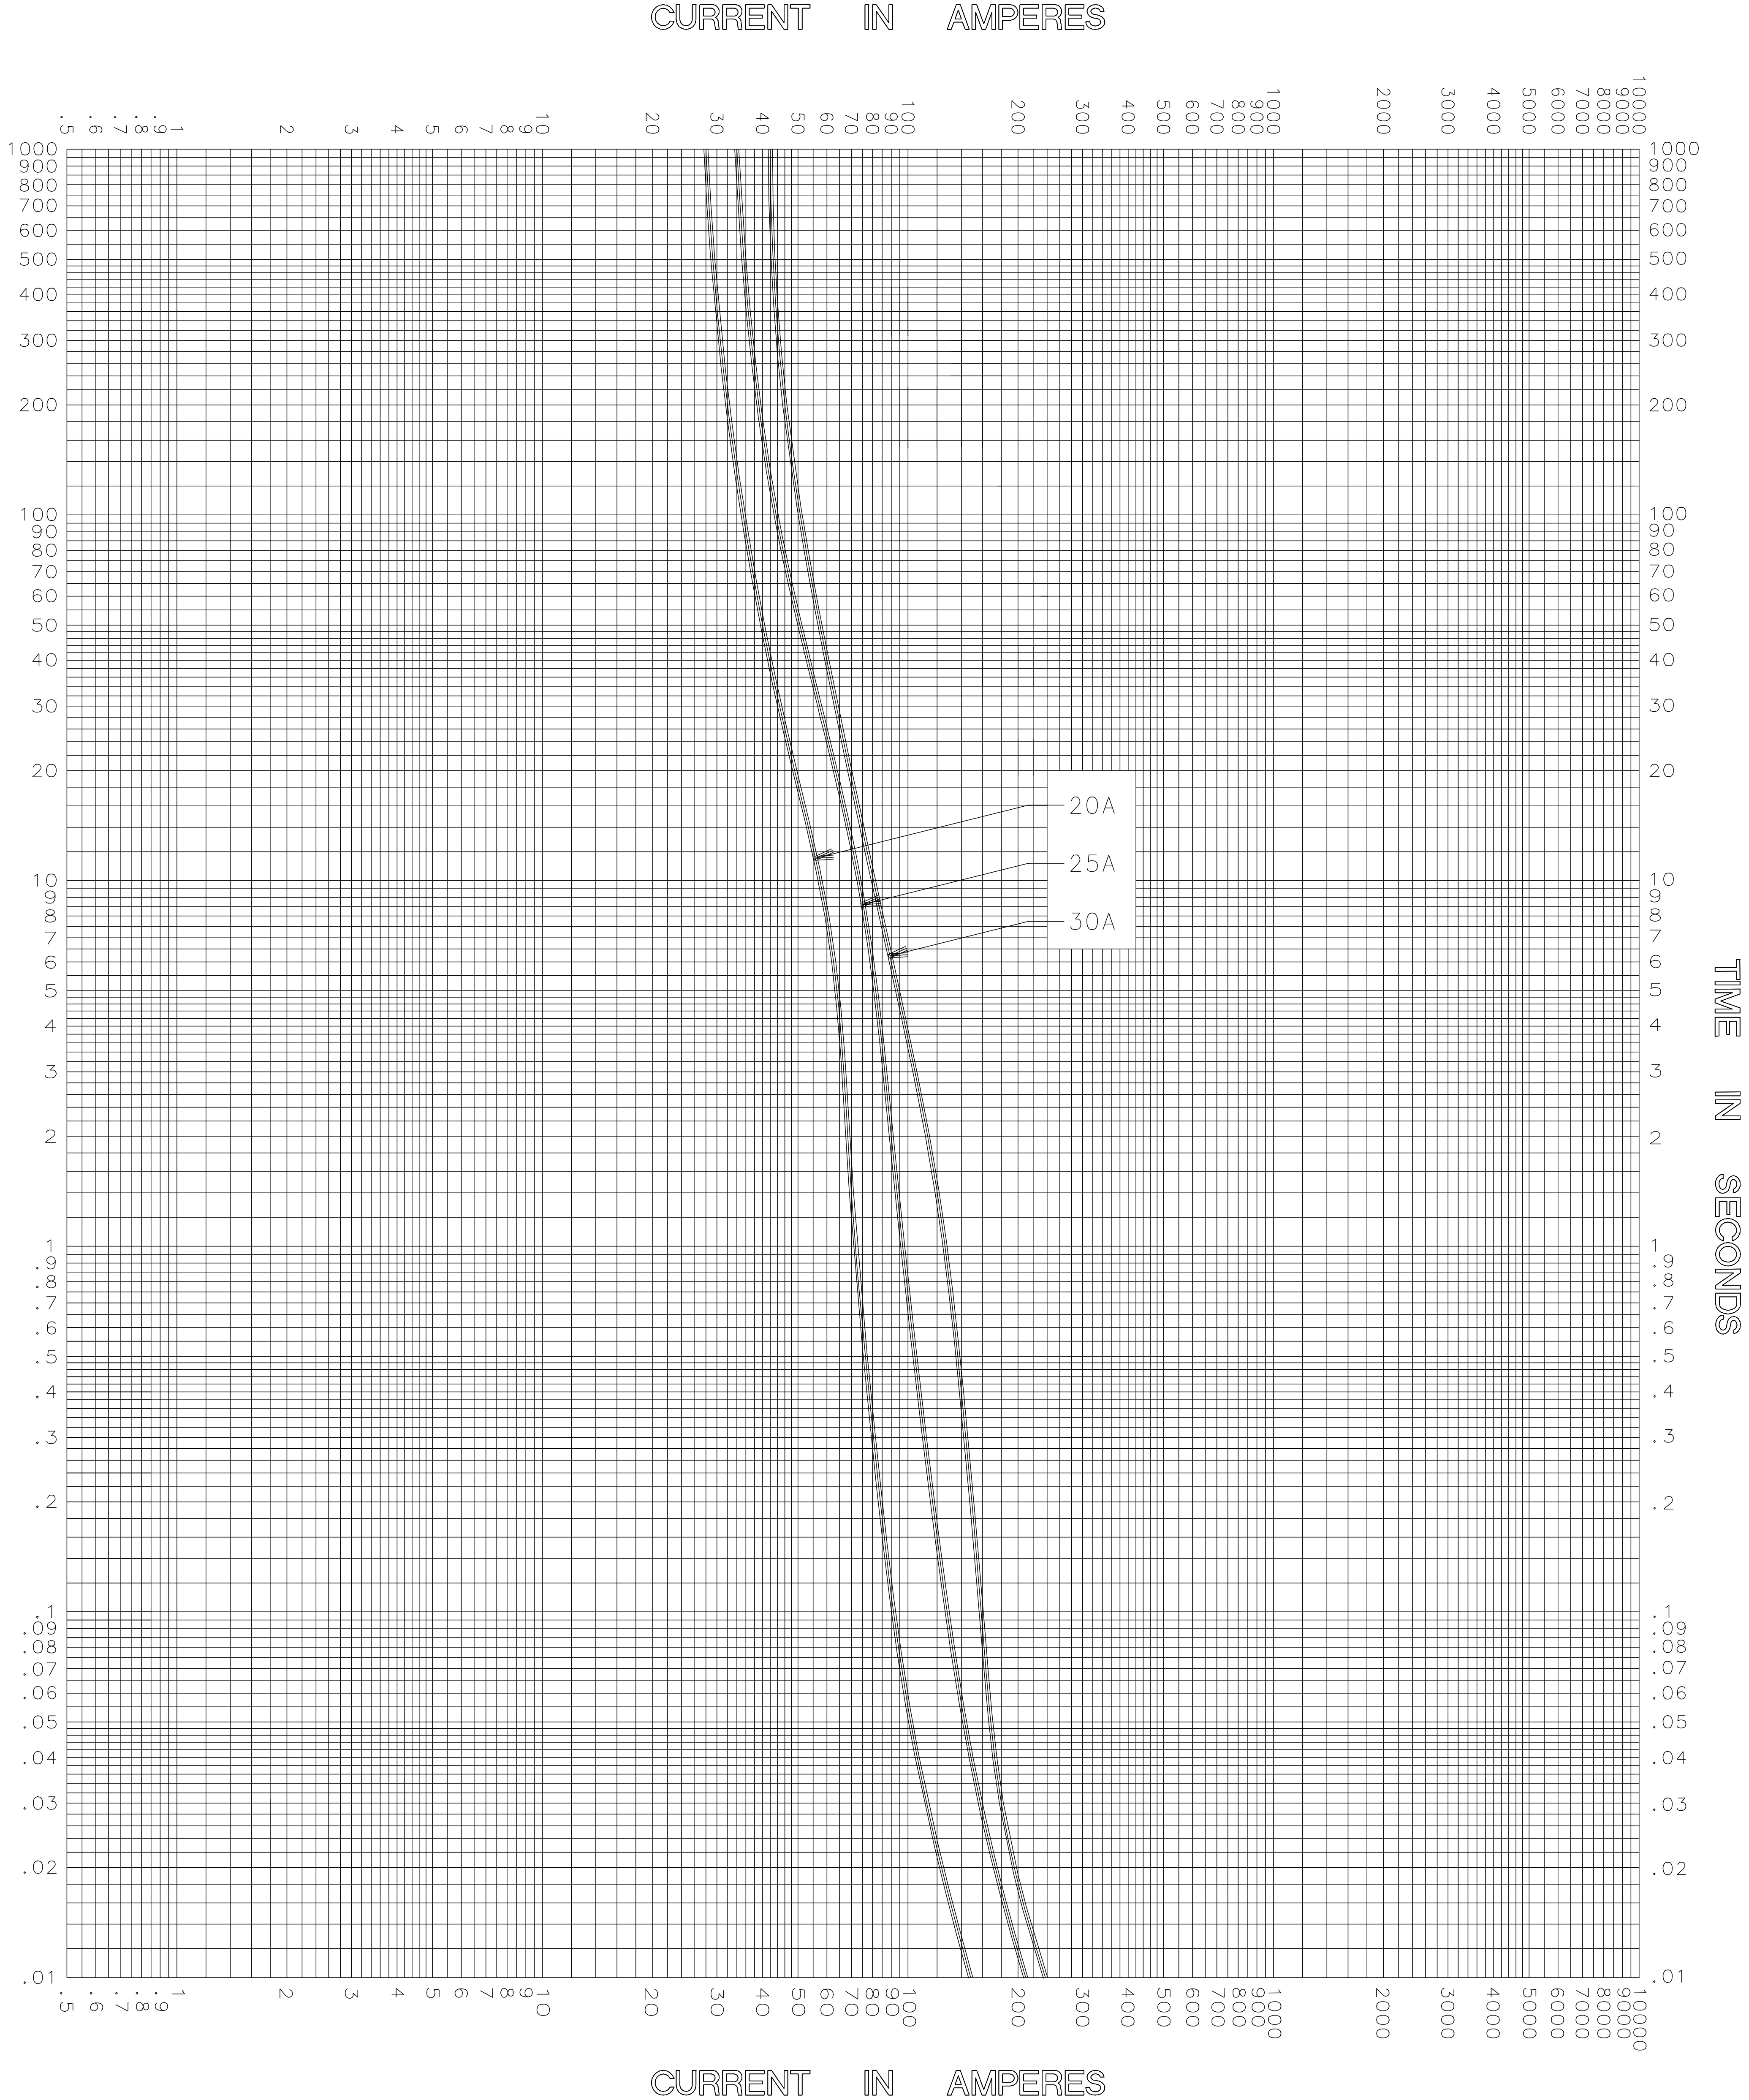

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
KLNR (20A - 30A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY MRD
DATE 02/19/03
CHECKED BY TN

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. B-FCC01 KLNR-002

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

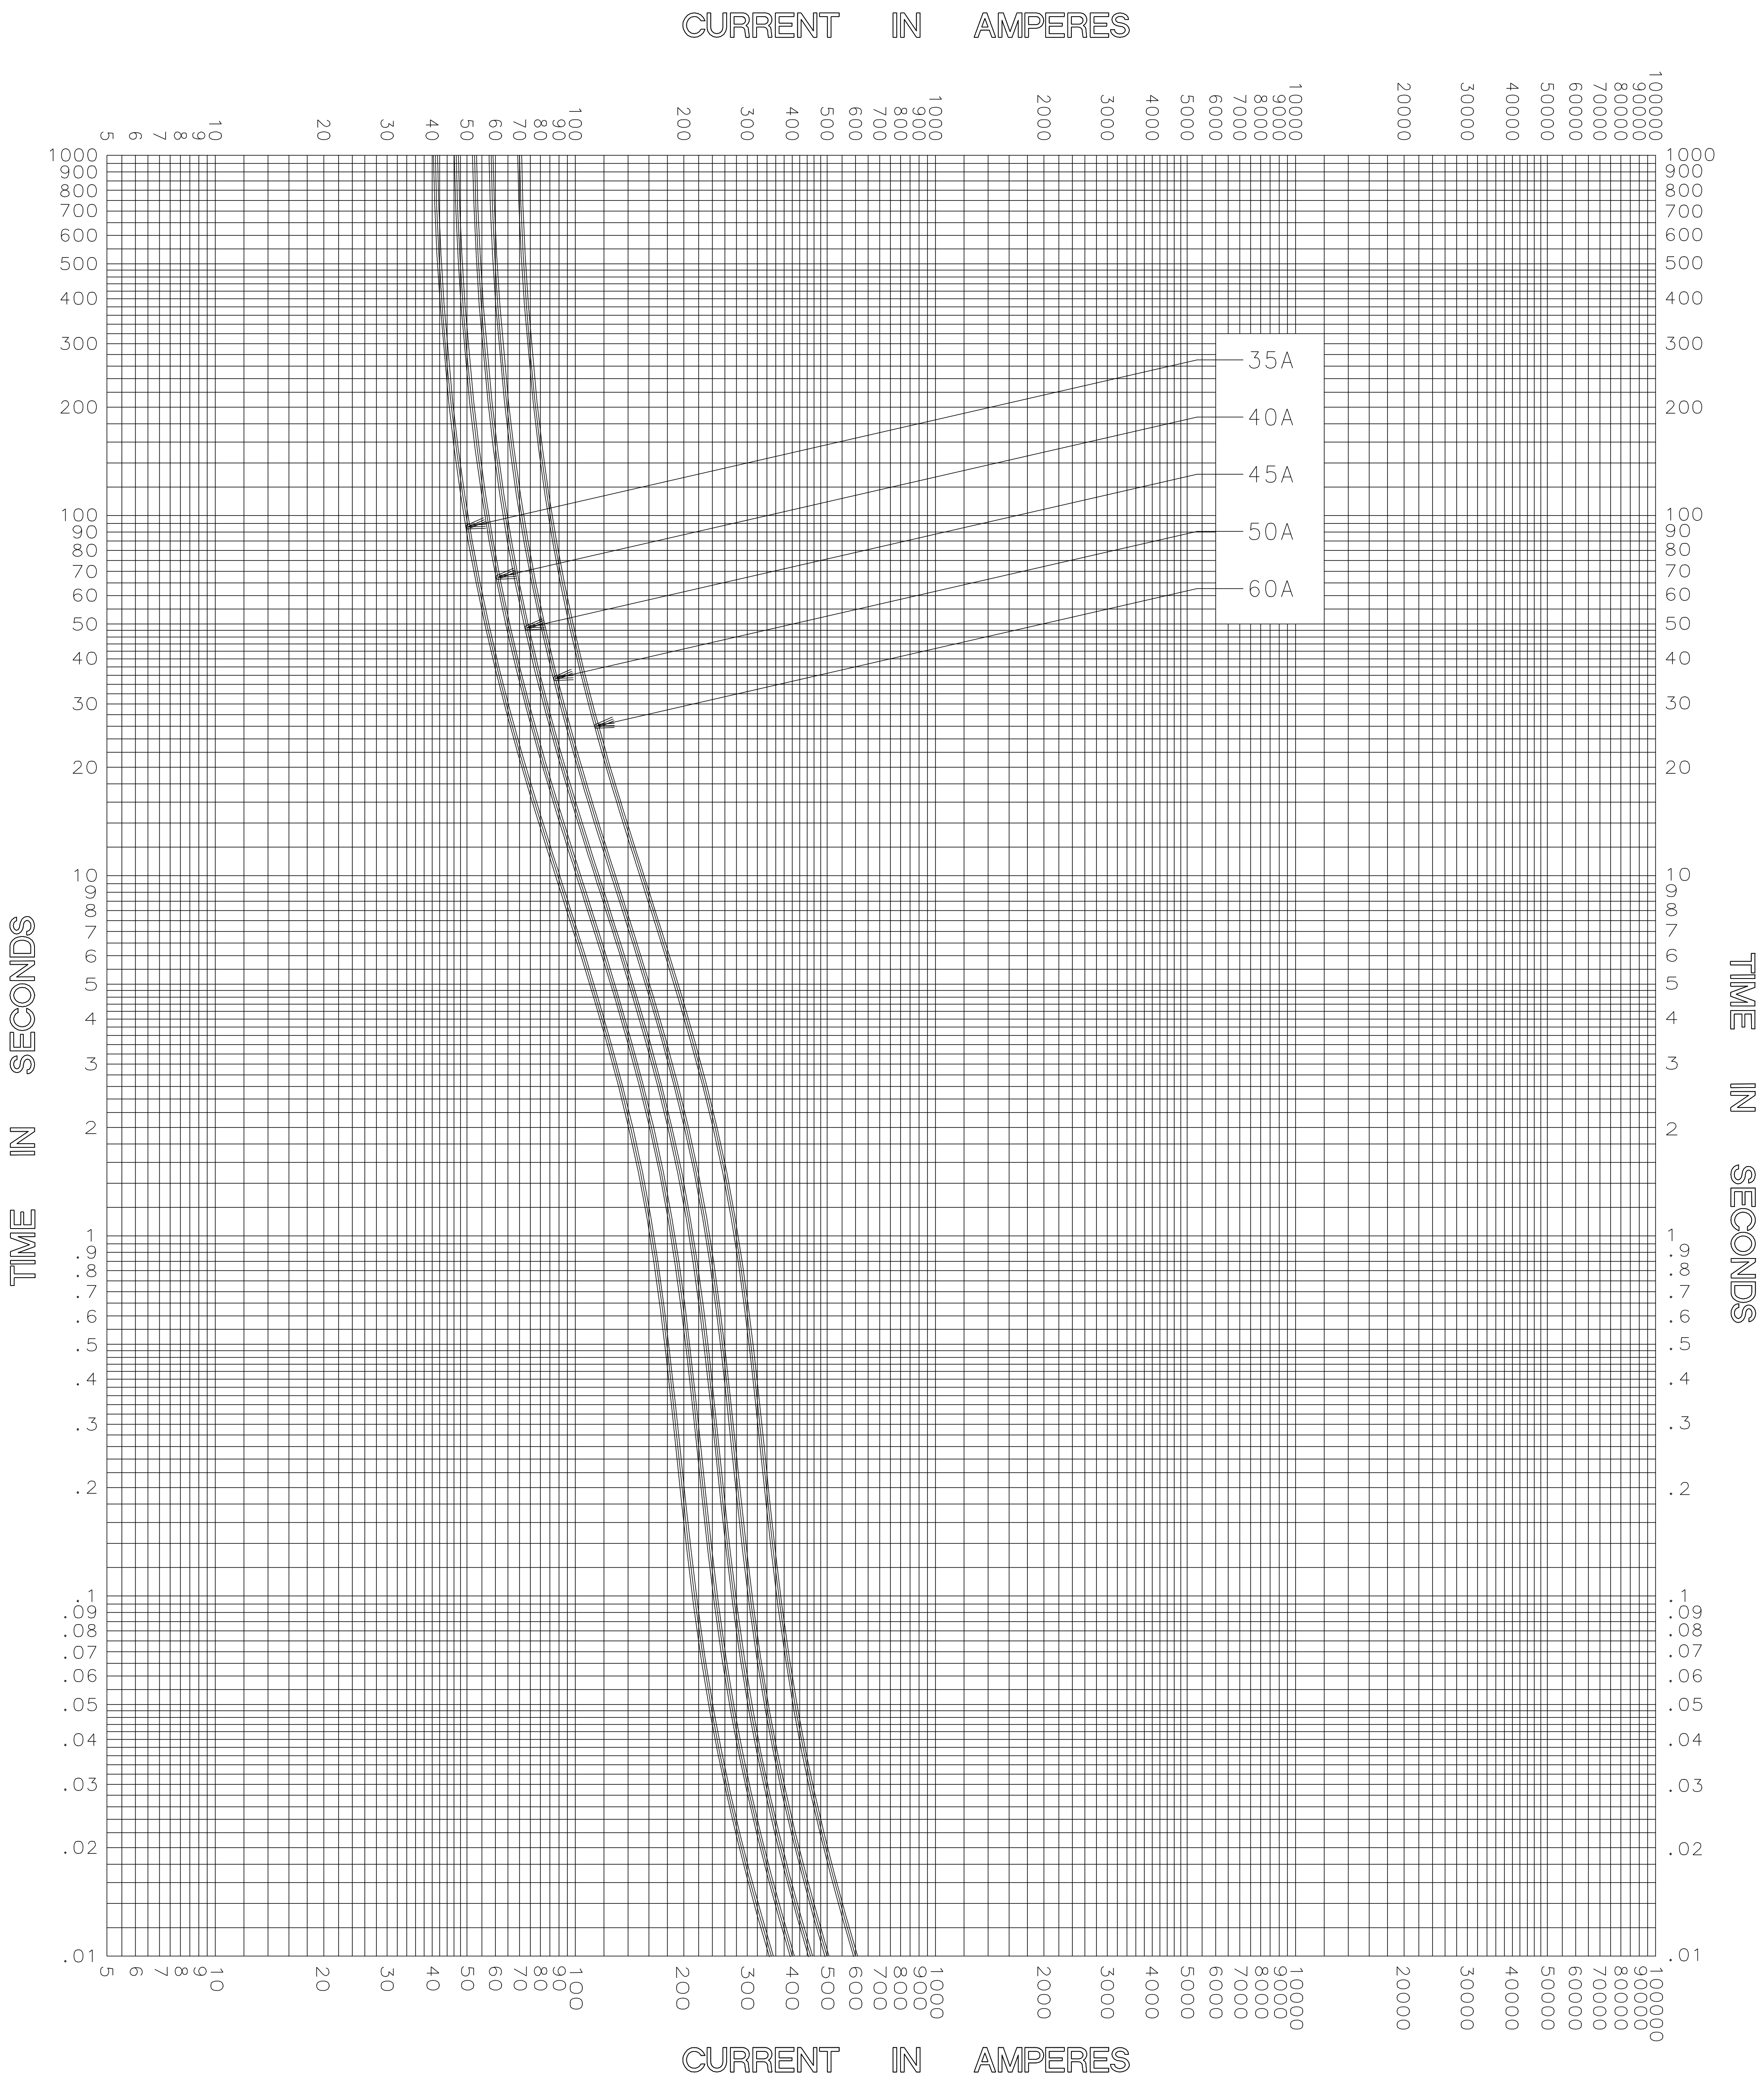


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		KLNR (35A - 60A)

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>01/14/05</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC0141R-003</u>


-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

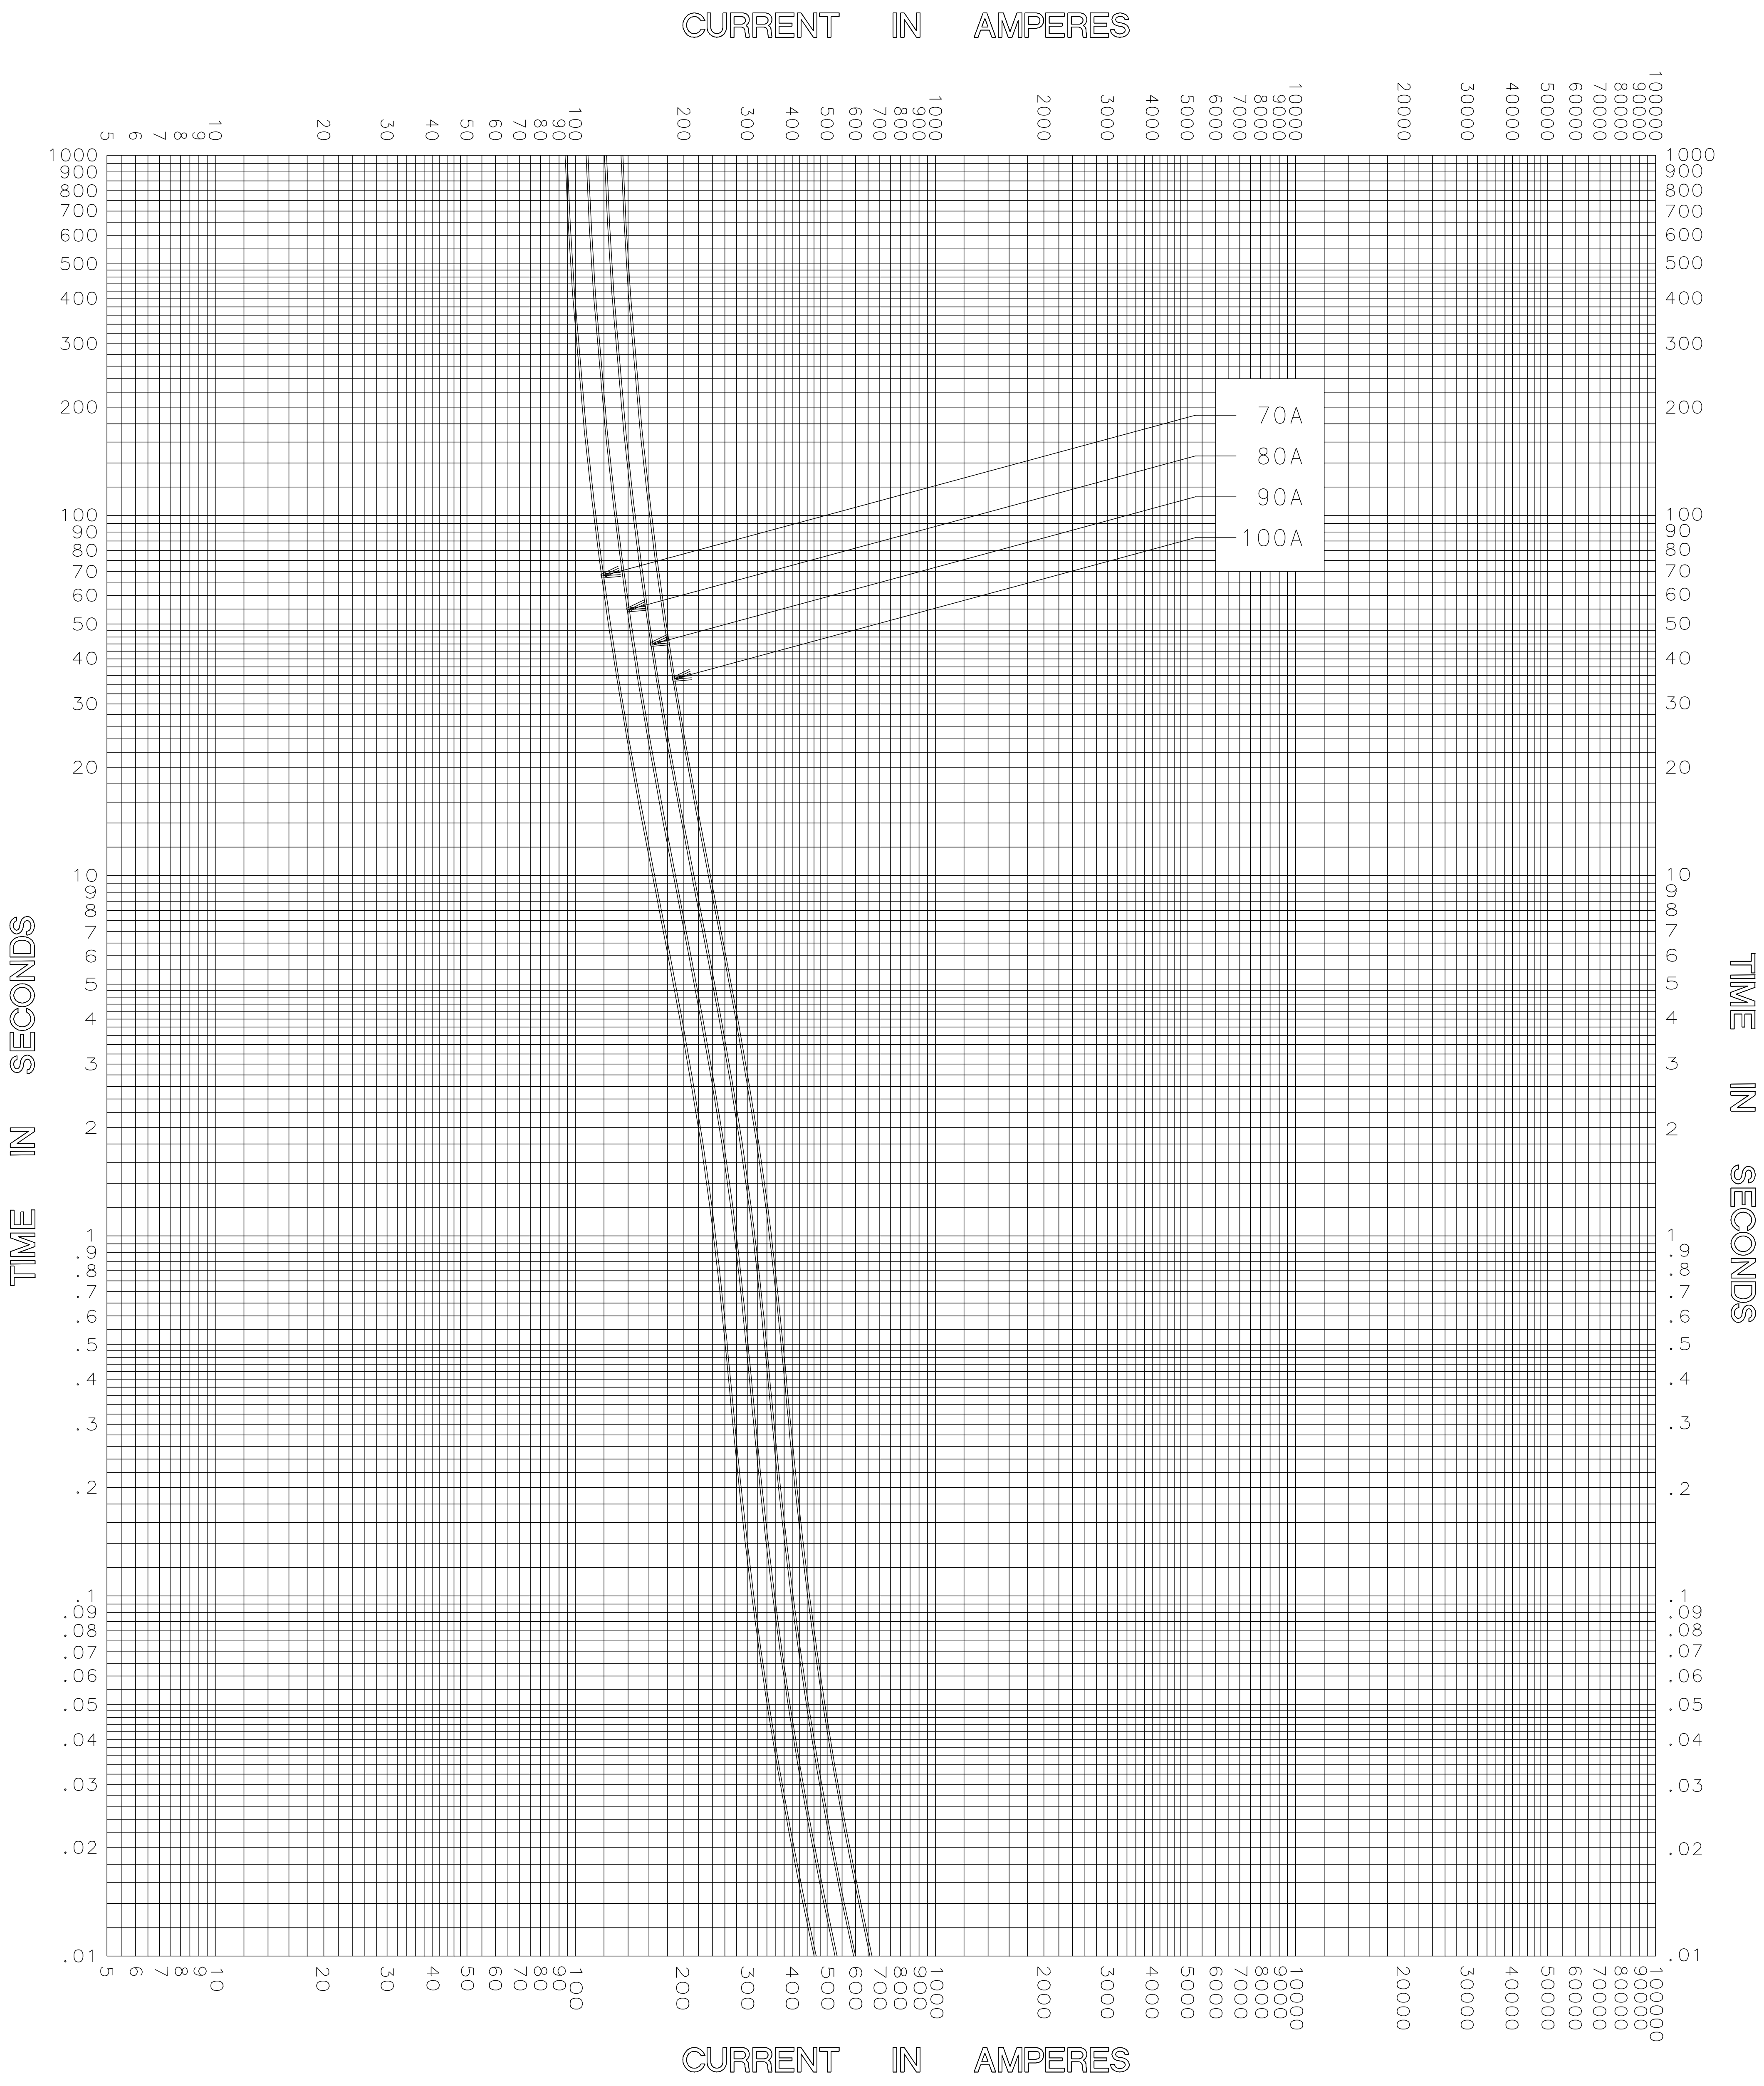

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
KLNR (70A - 100A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 01/14/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC014-004

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

SECONDS IN TIME

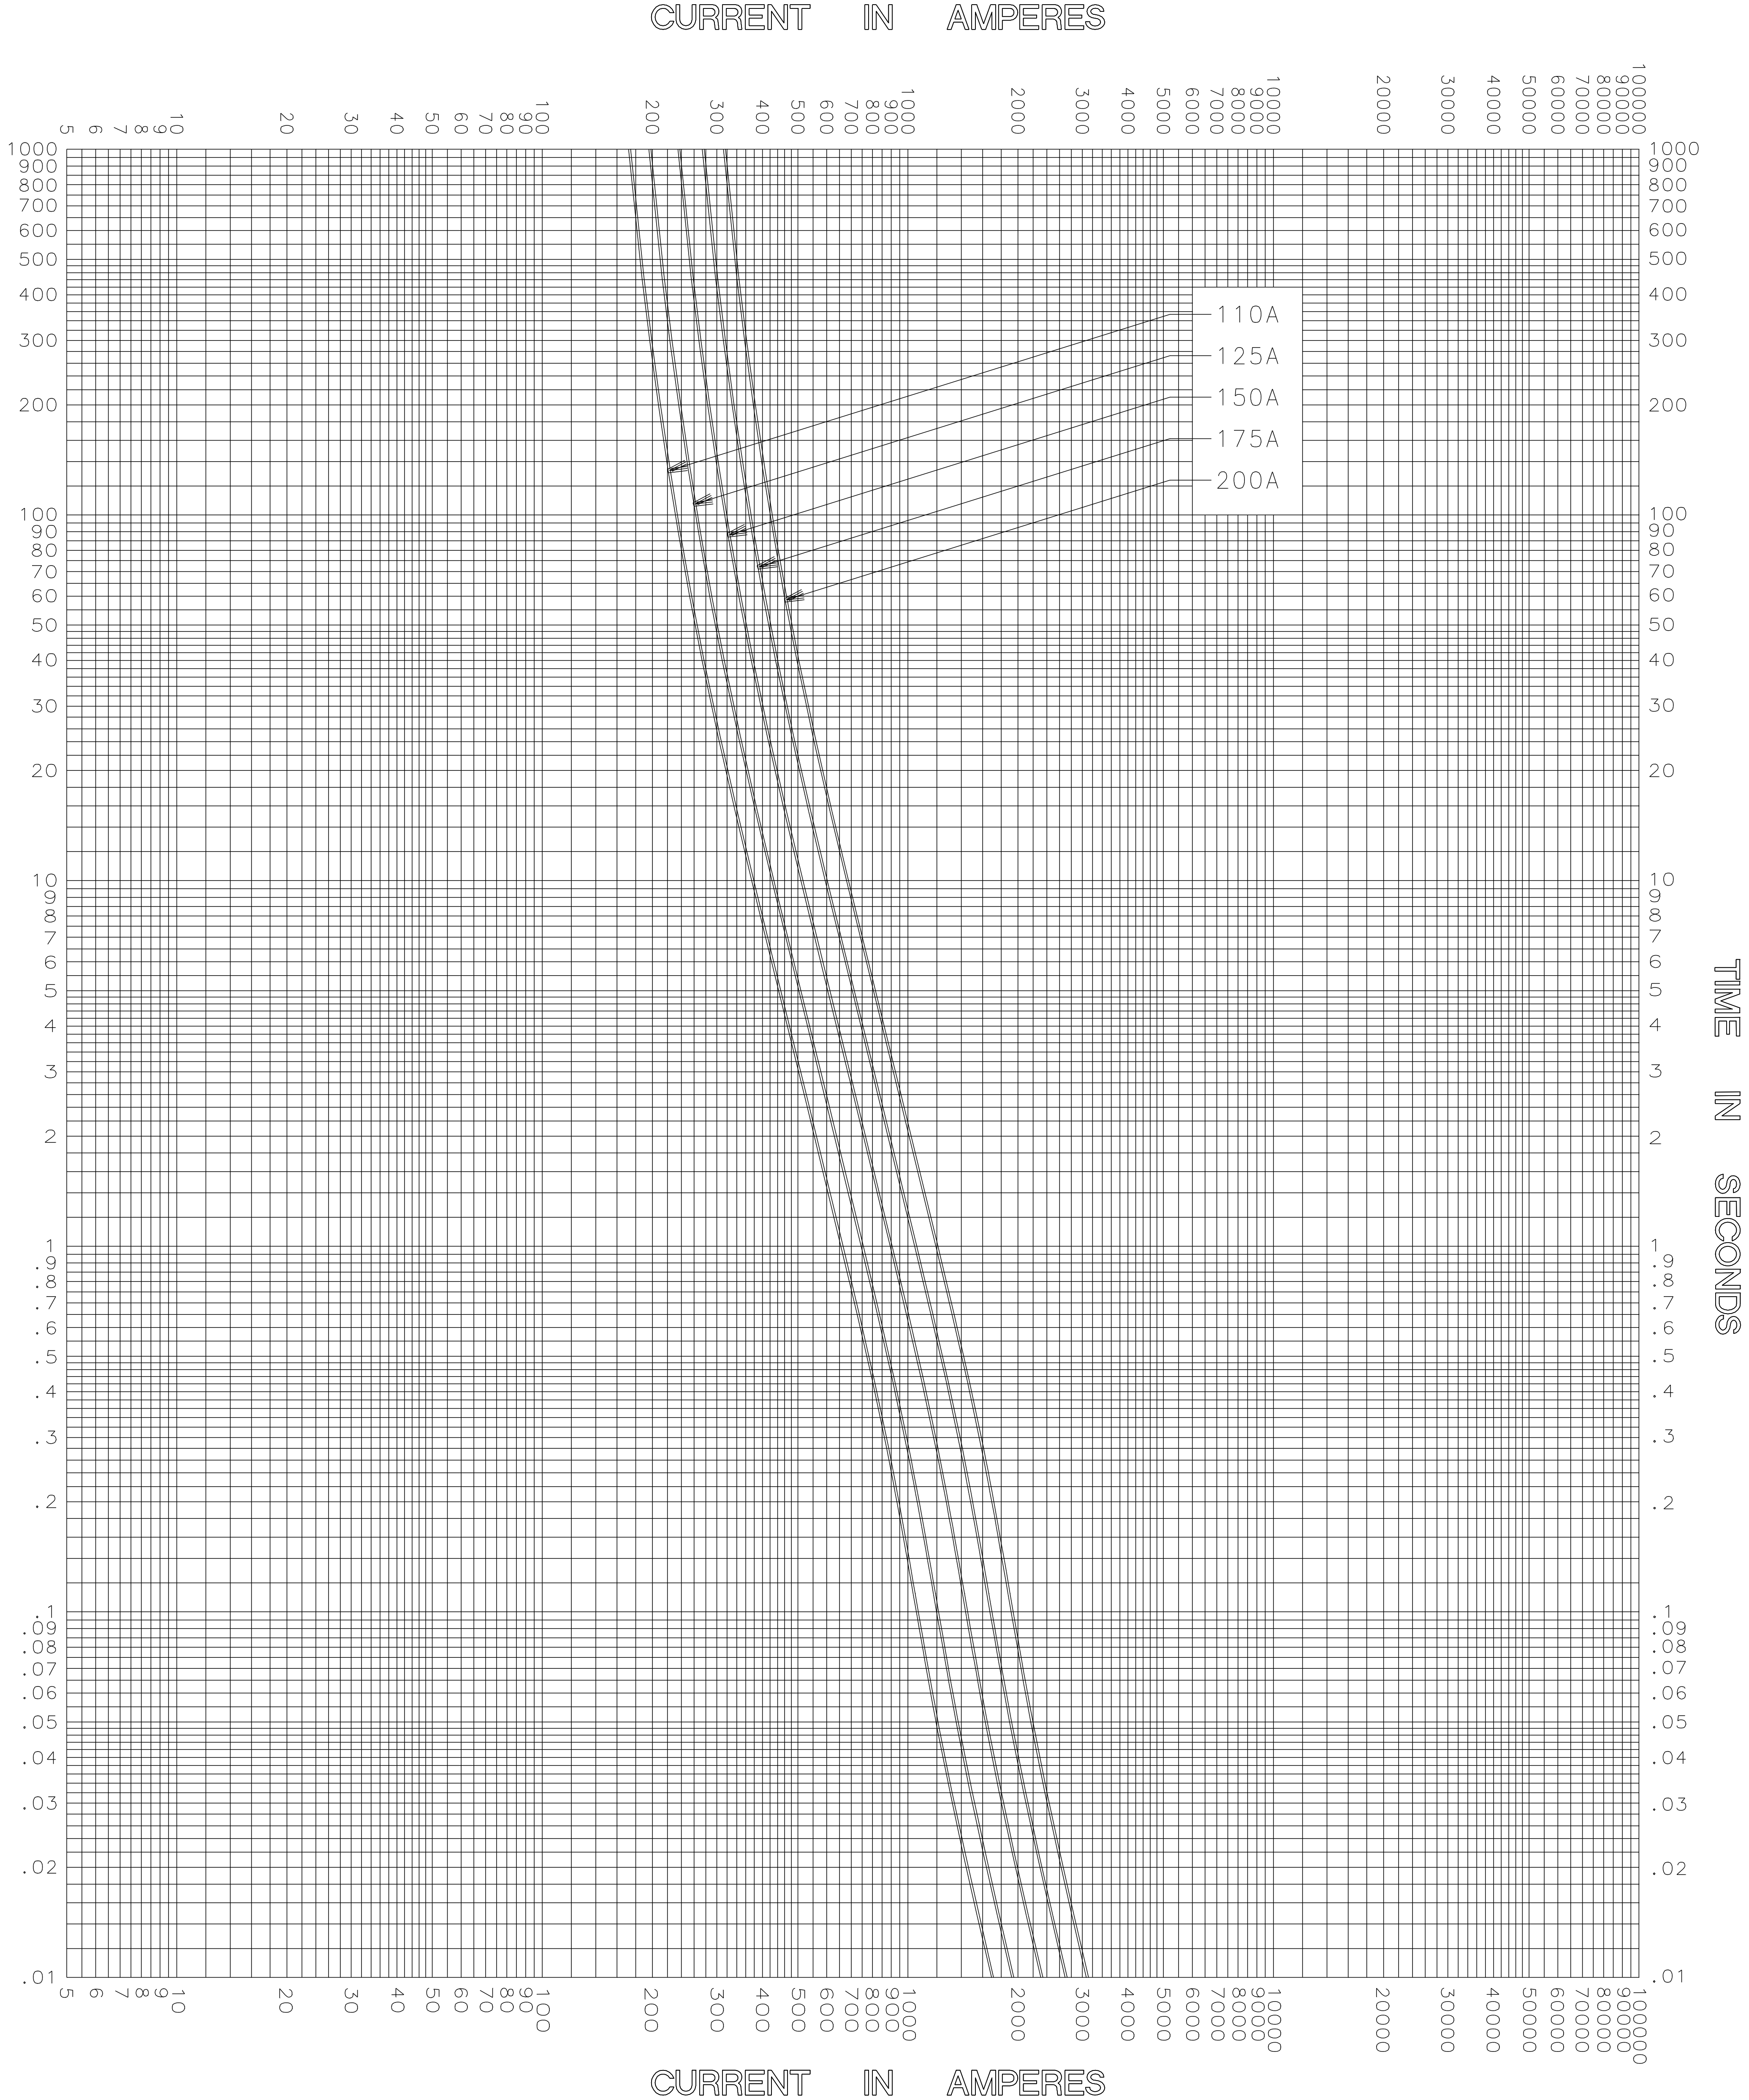

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
KLNR (110A - 200A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 01/14/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC011NR-005

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

SECONDS IN TIME

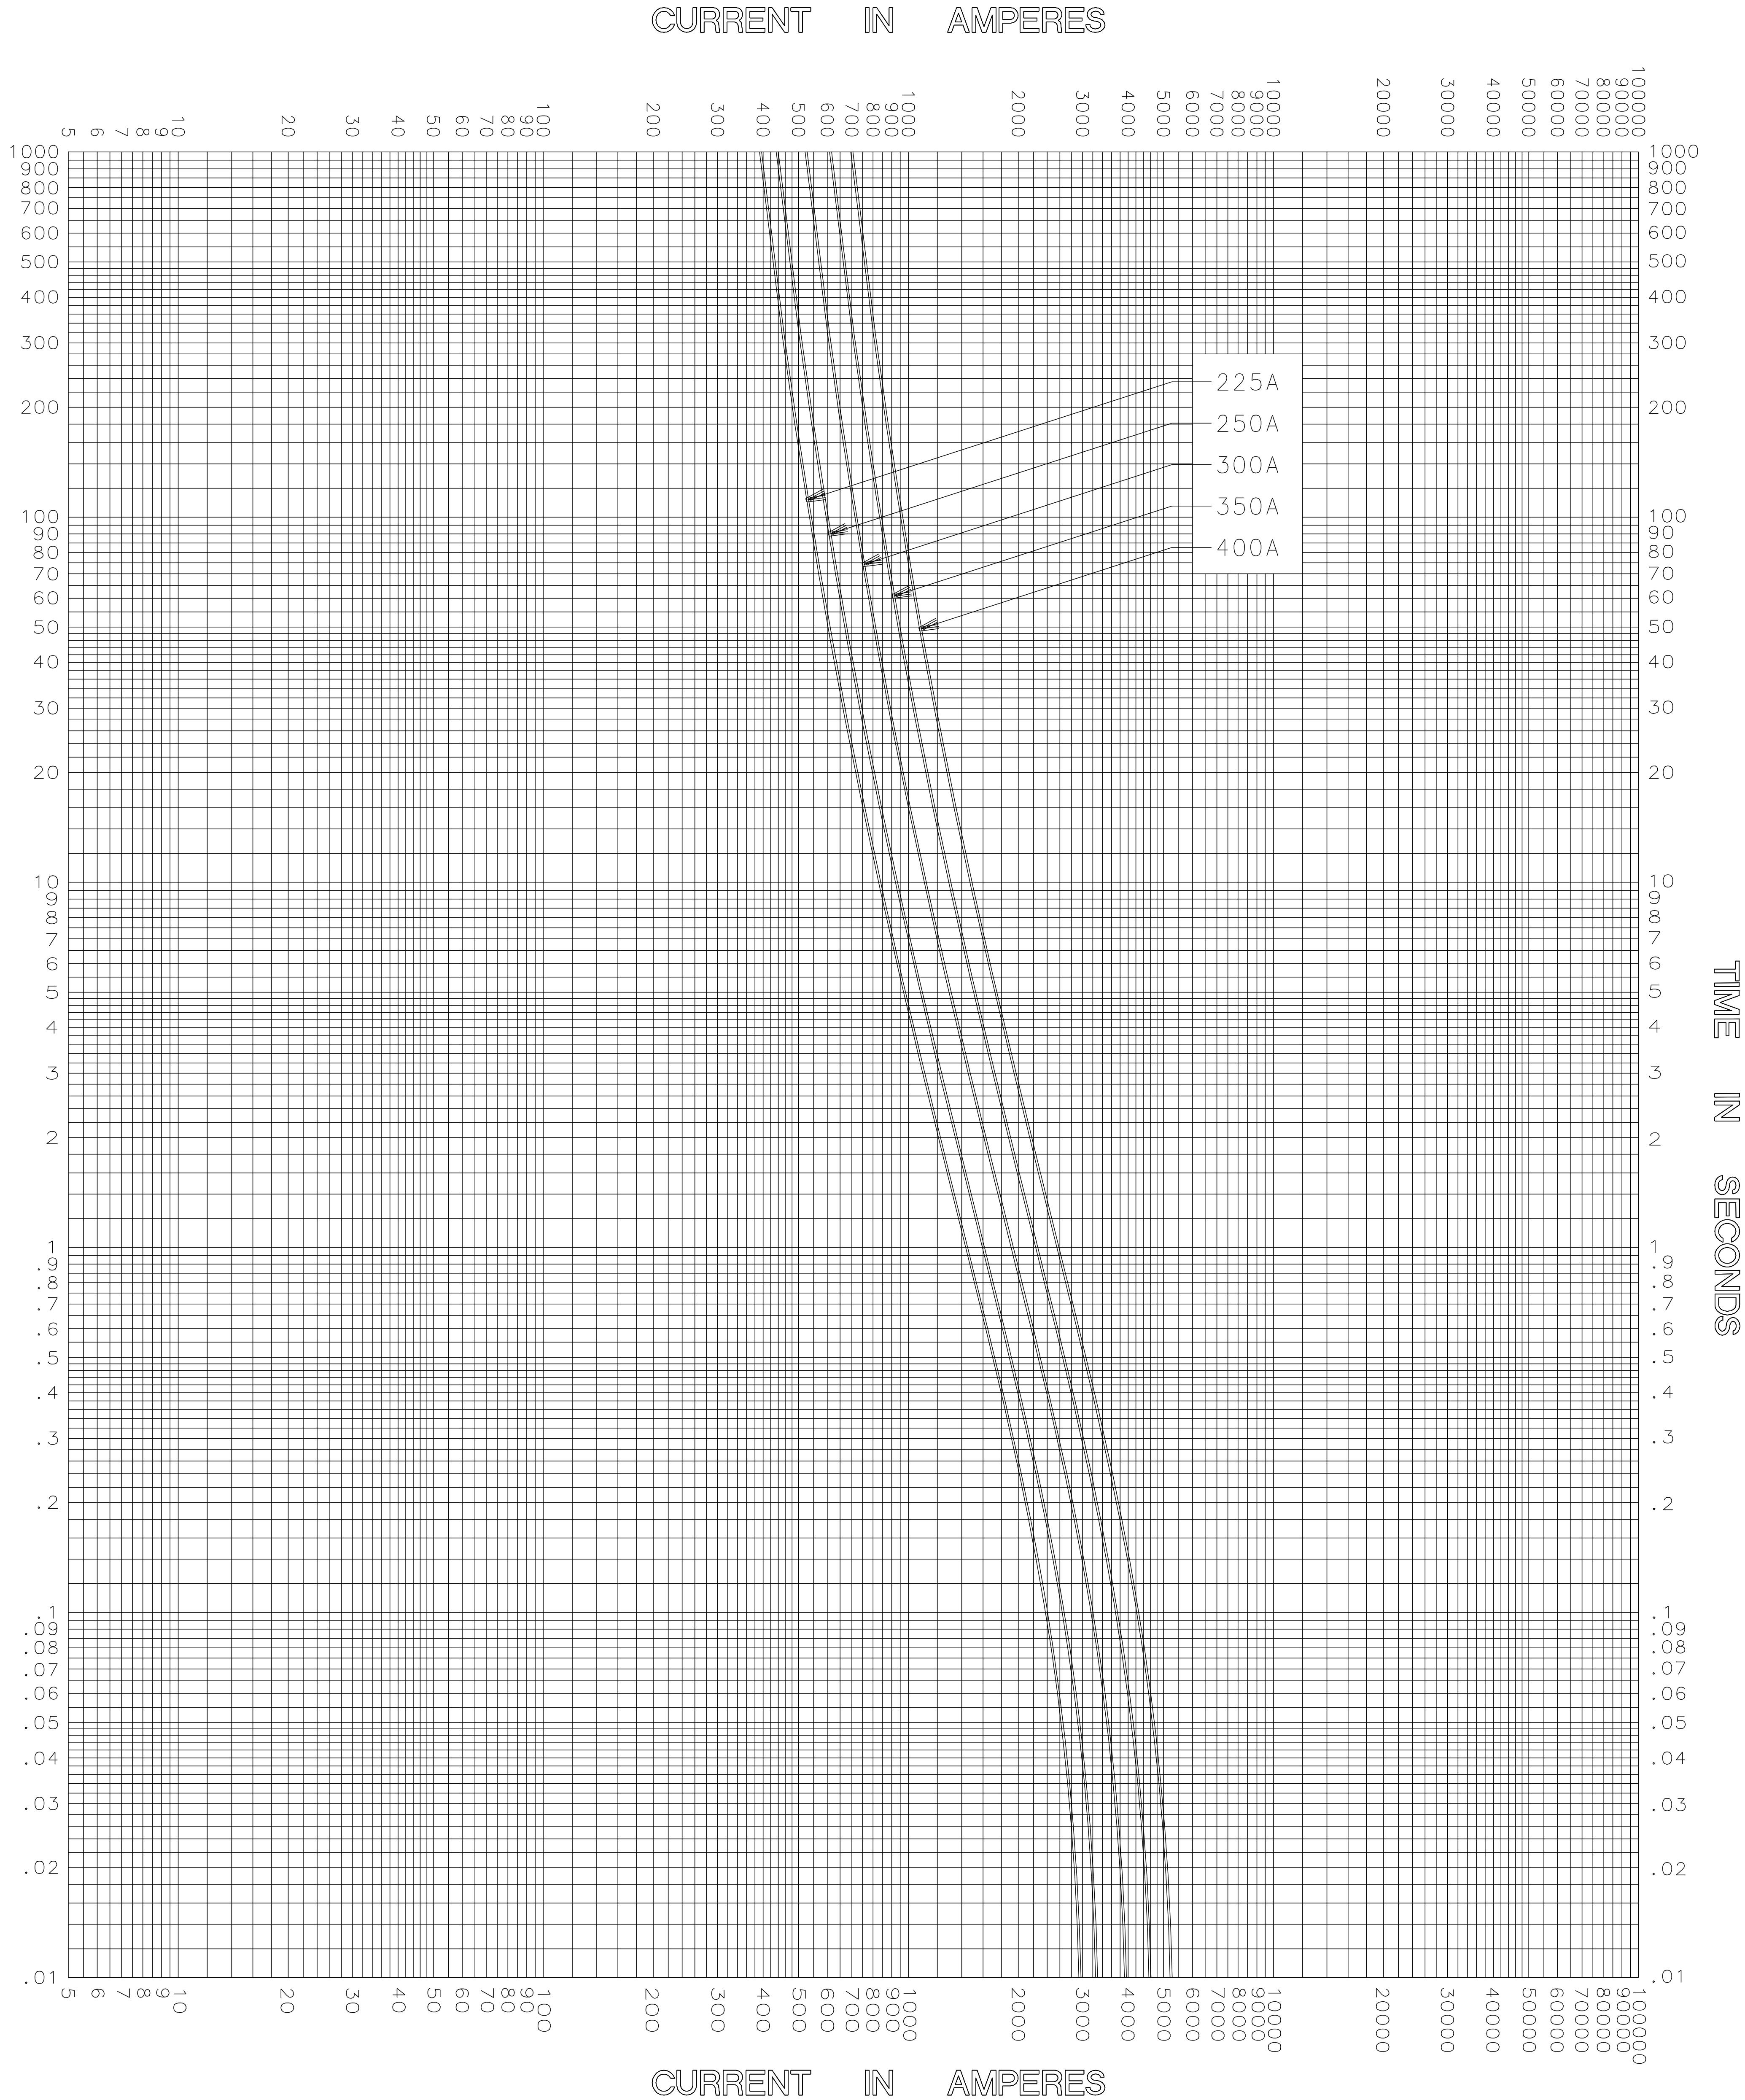

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
KLNR (225A - 400A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 01/14/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC0141R-006

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

SECONDS IN TIME

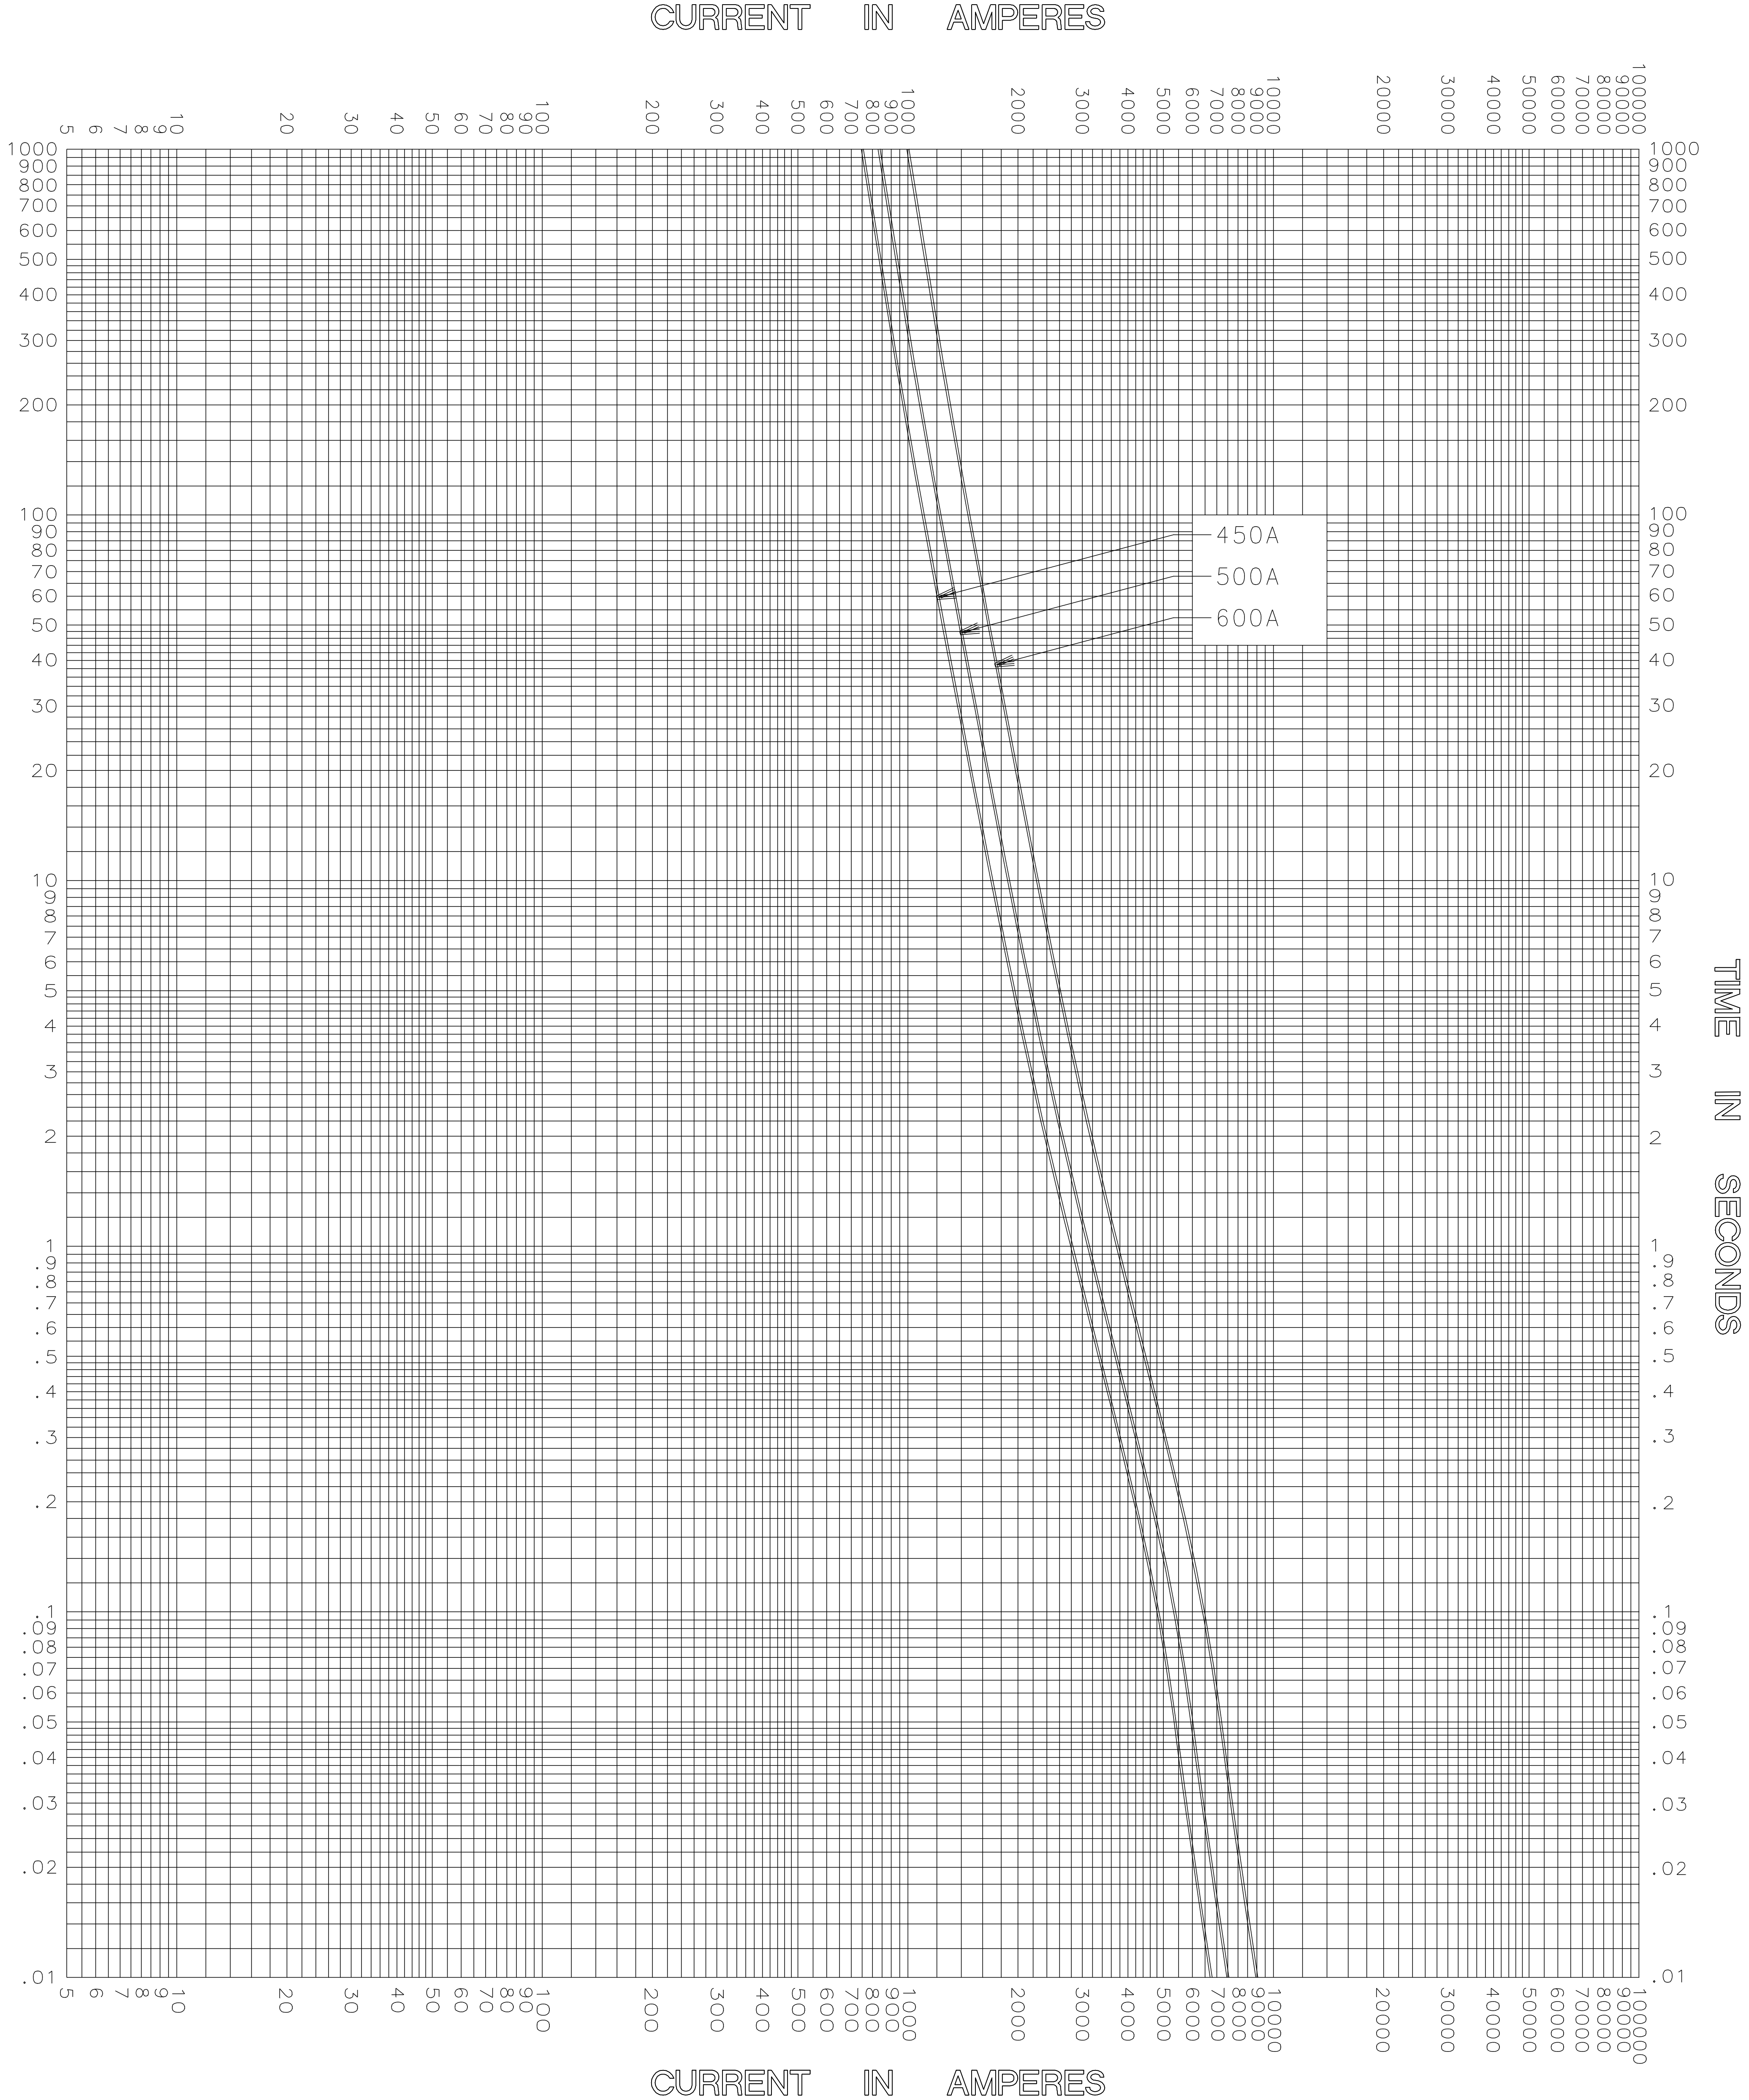

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
KLNR (450A - 600A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/14/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC0141R-007

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

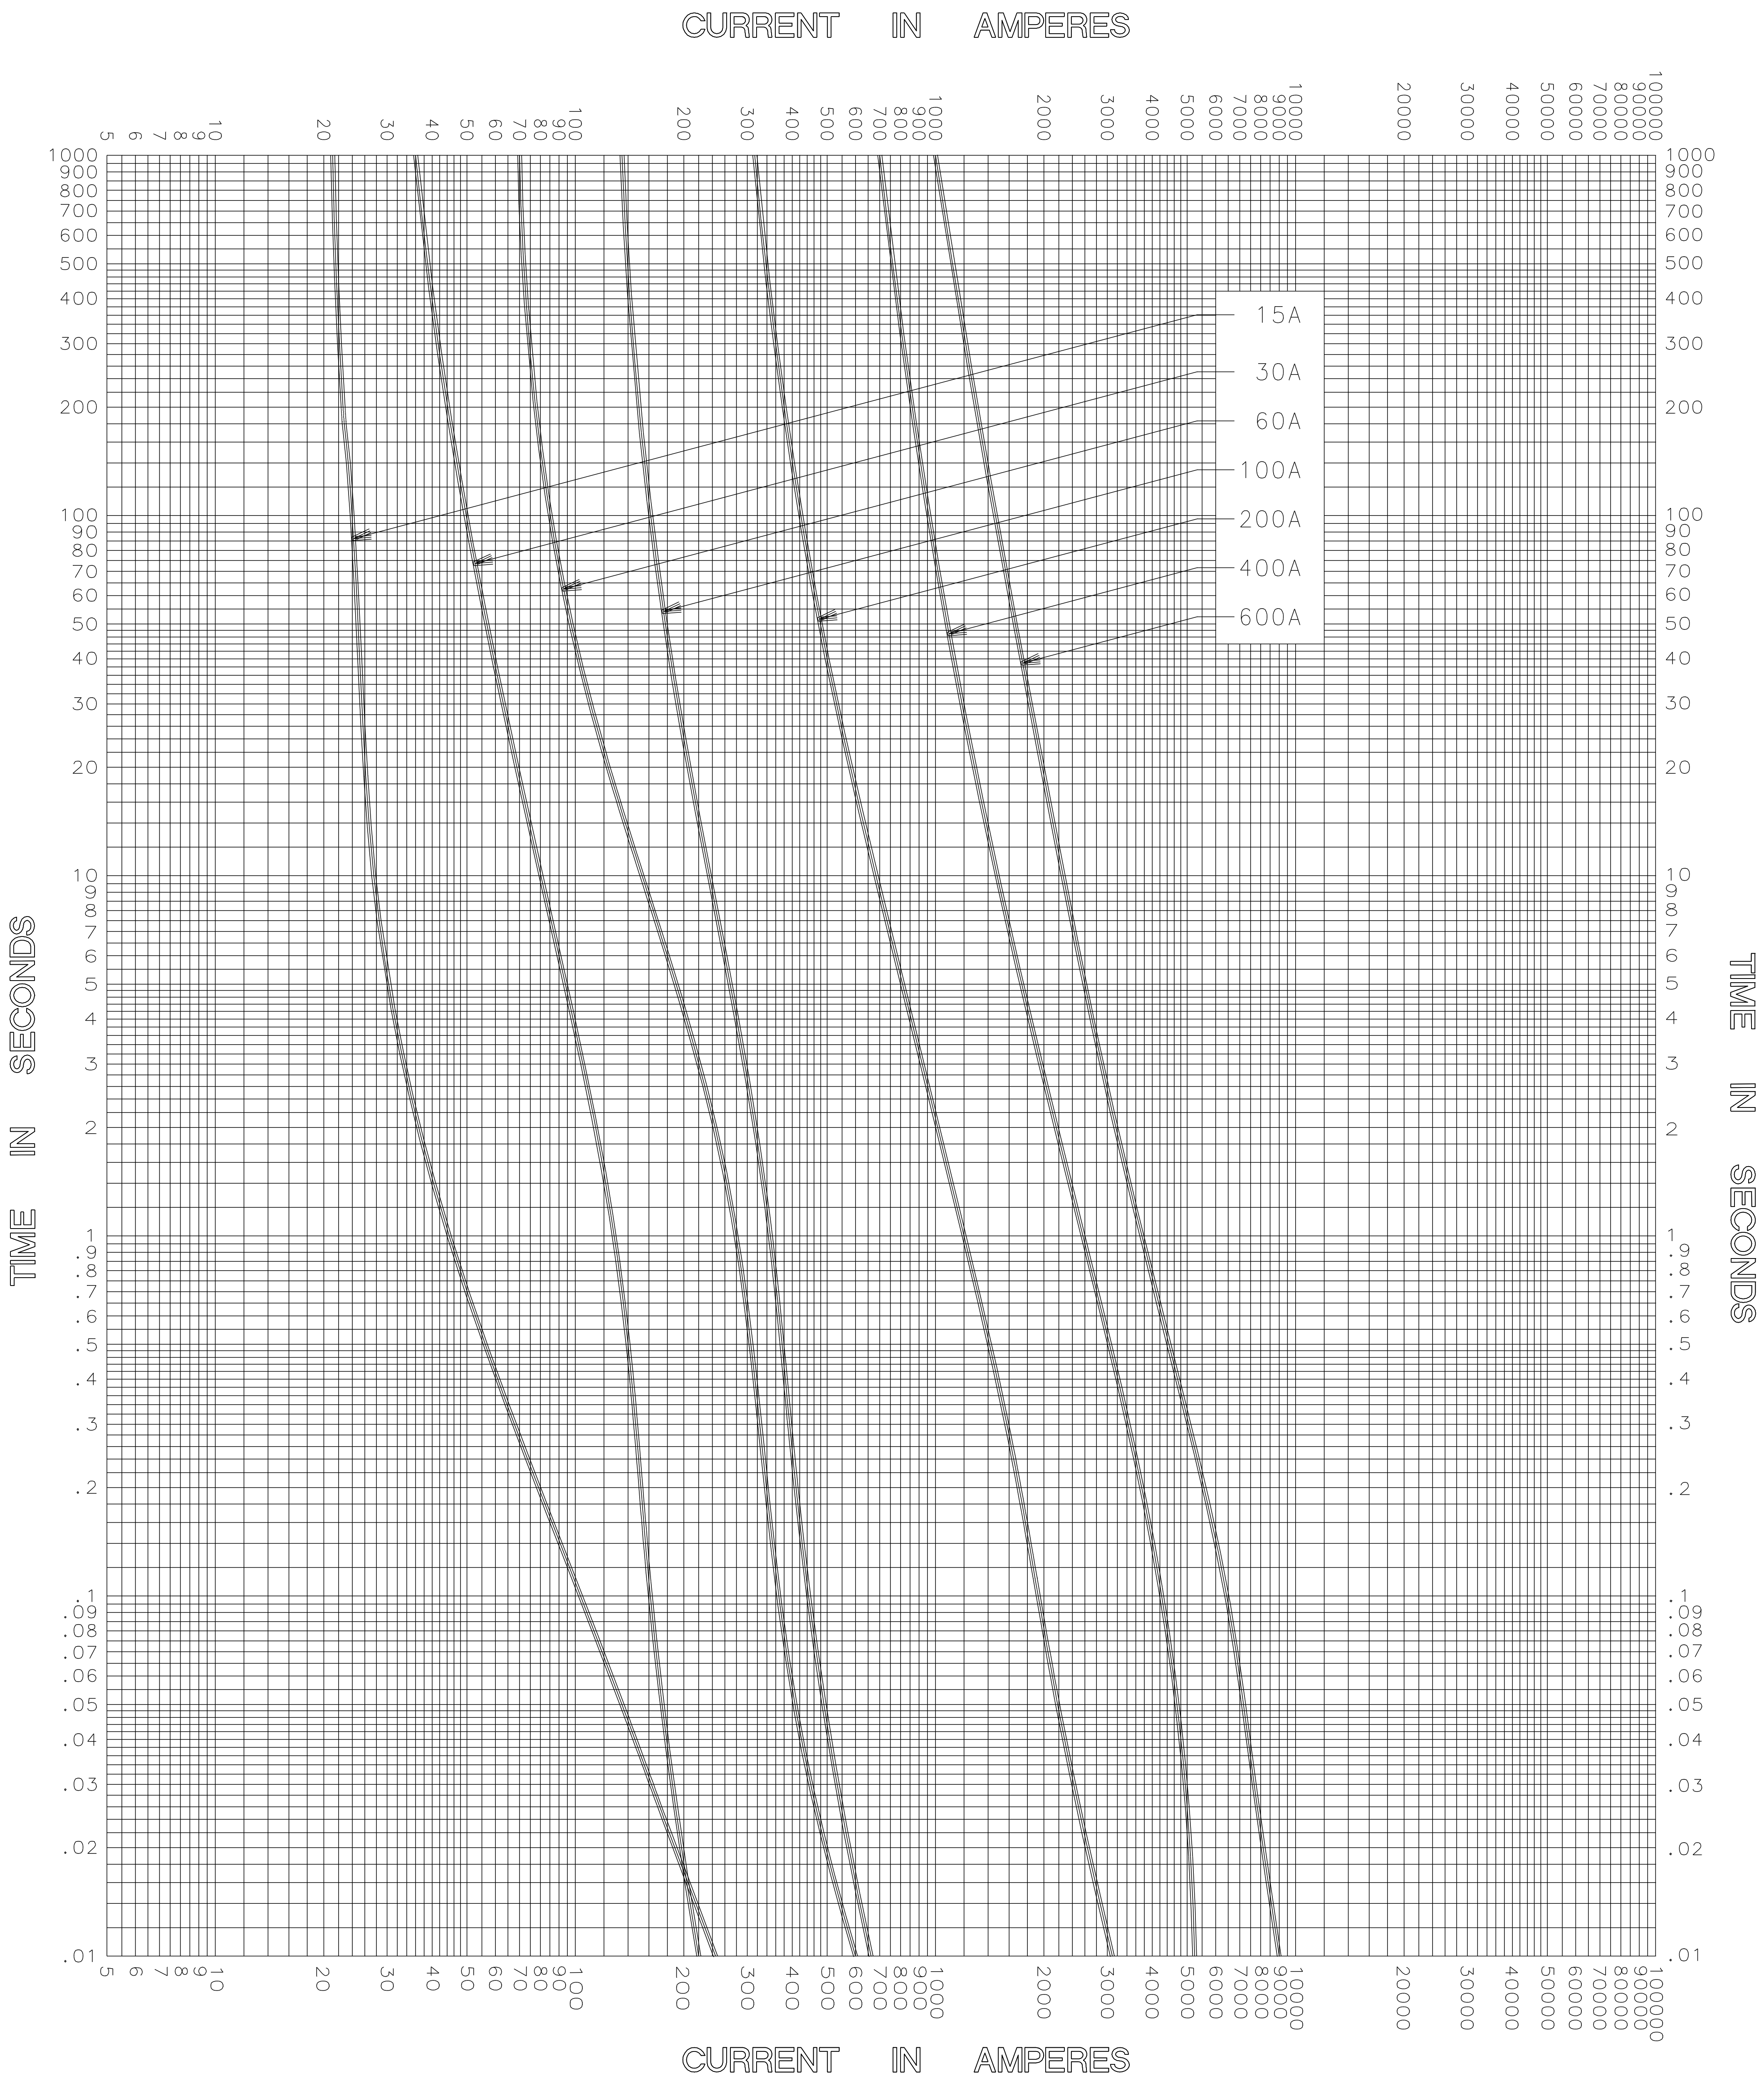

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
KLNR (15A - 600A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 01/14/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC011NR-008

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT